MARLOW

SUBMITTAL

M-530.38A

JOB:	**REPRESENTATIVE:**	
UNIT TAG:	**ORDER NO.**	**DATE:**
ENGINEER:	**SUBMITTED BY:**	**DATE:**
CONTRACTOR:	**APPROVED BY:**	**DATE:**



4-9SC
Series 530
Close-Coupled Centrifugal Pumps

SPECIFICATIONS

FLOW _____ HEAD _____

HP _____ RPM _____

VOLTS _____

CYCLE _____ PHASE _____

ENCLOSURE _____

APPROX. WEIGHT _____

SPECIALS _____

MATERIALS OF CONSTRUCTION

☐ BRONZE FITTED ☐ ALL IRON

MAXIMUM WORKING PRESSURE

☐ 175 psi (12 bar) W.P.
with 125# ANSI flange drilling

TYPE OF SEAL

☐ 530 Standard Seal
(Buna-Carbon/Ceramic)

☐ 530 -F Standard Seal w/ Flush Line
(Buna-Carbon/Ceramic)

☐ 530 -S Stuffing Box construction w/ Flushed Mechanical Single Seal
(EPR-Tungsten Carbide/Carbon)

☐ 530 -D Stuffing Box construction w/ Flushed Double Mechanical Seal
(EPR-Carbon/Ceramic)
Requires external water source

☐ 530 -PF Stuffing Box Construction
w/ Flushed Packing
(Graphite Impregnated Teflon)

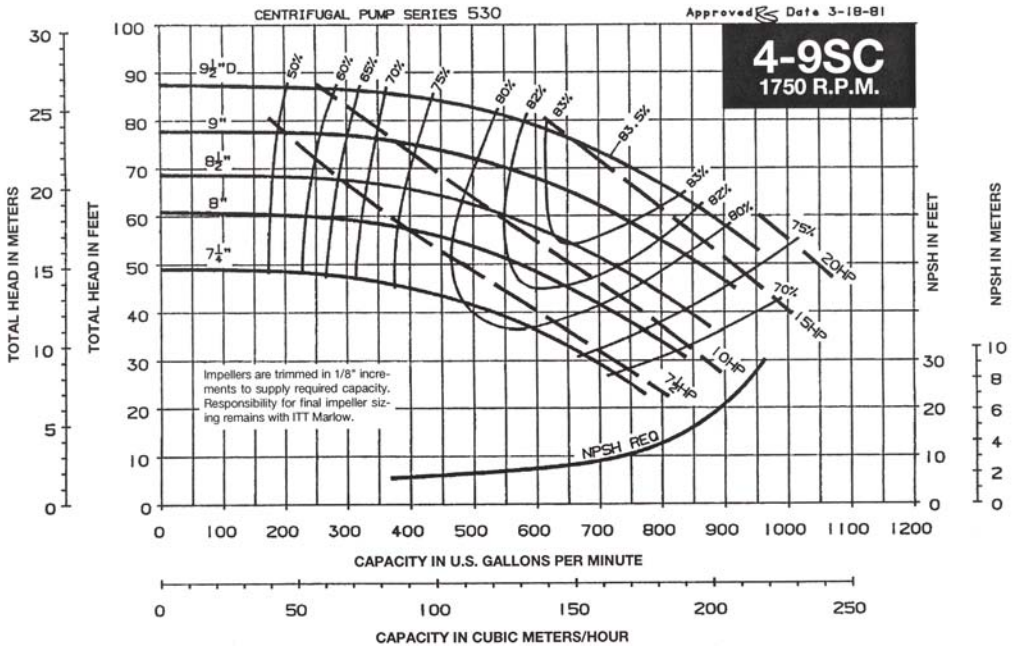

Marlow
ITT Industries
Engineered for life

© COPYRIGHT 2003 ITT INDUSTRIES, INC.